

Airbox F40

www.HYG.de

Allgemeine Raumluftechnik


- ✓ VDI 6022, Blatt 1 (01/2018)
- ✓ DIN 1946, Teil 4 (09/2018)
- ✓ SWKI VA104-01 (01/2019)
- ✓ SWKI VA105-01 (08/2015)
- ✓ ÖNORM H 6020 (06/2019)
- ✓ ÖNORM H 6021 (08/2016)

Hygiene Konformitätsprüfung

W-365259-22-Zd

Gültigkeitszeitraum

02/2023 - 02/2028

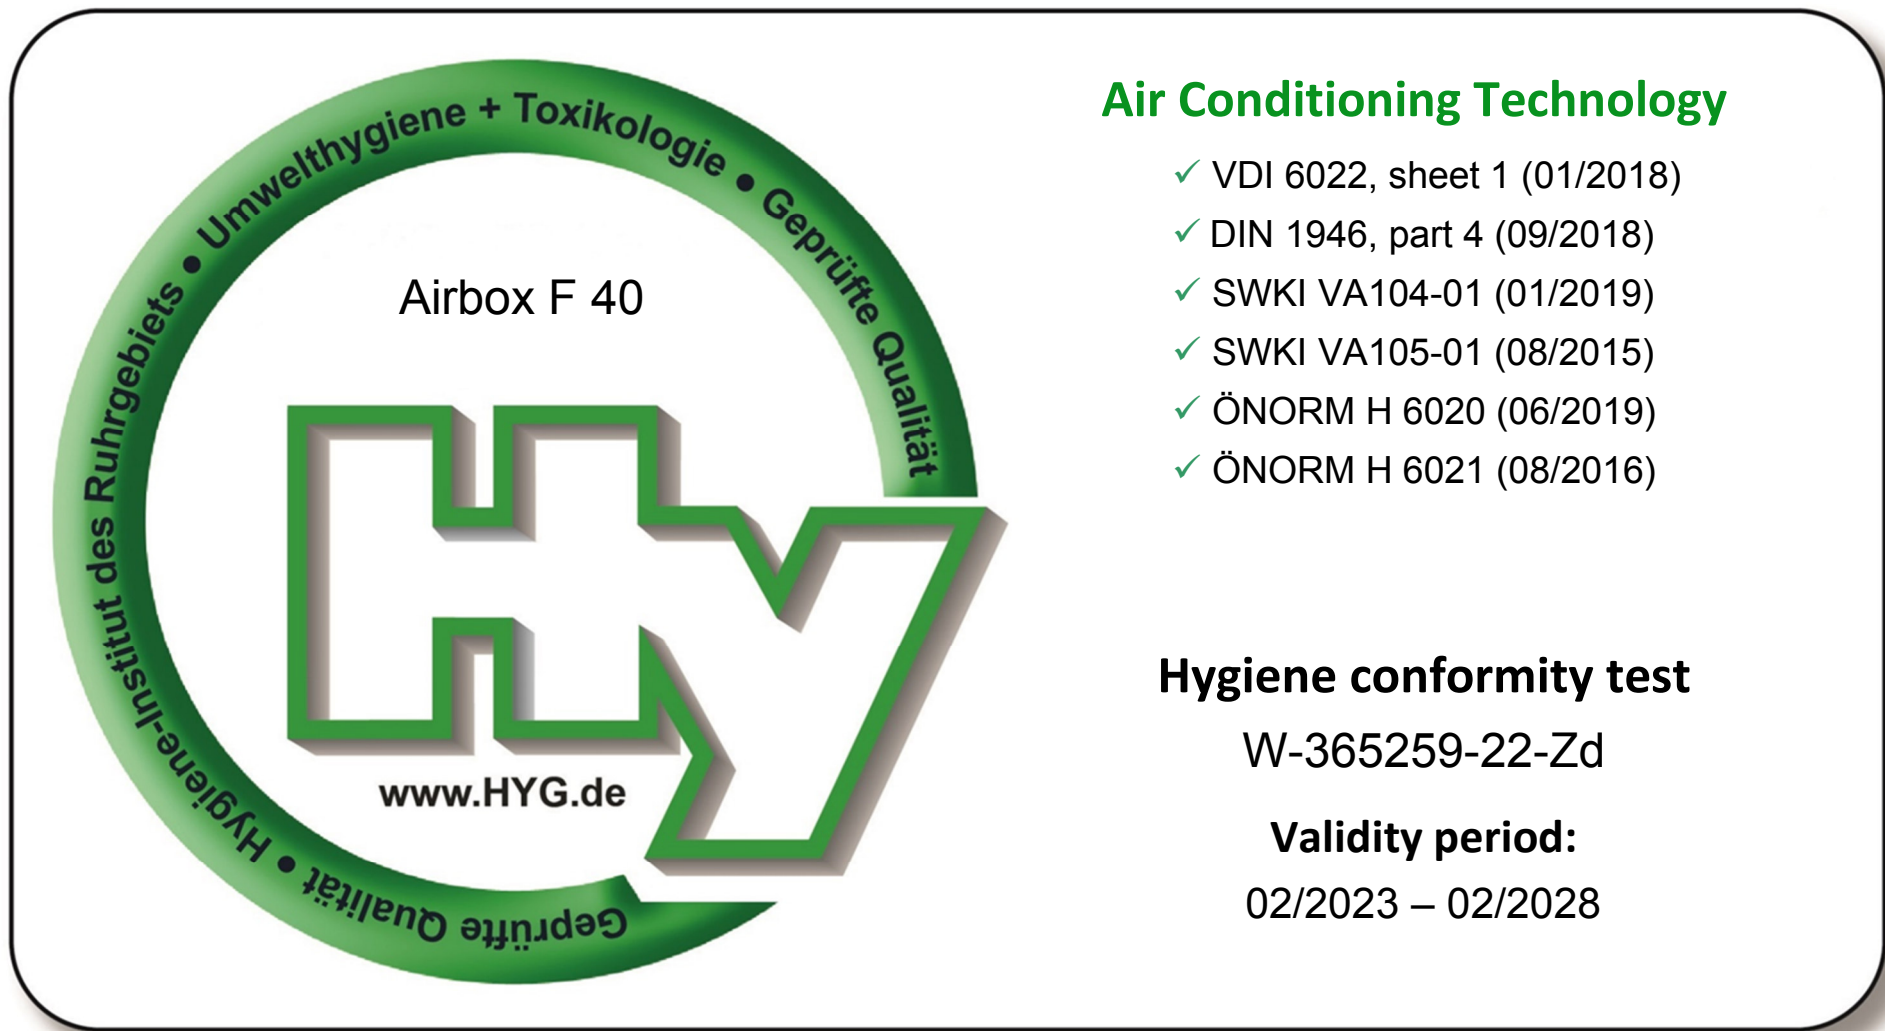

Airbox F 40

www.HYG.de

Air Conditioning Technology

- ✓ VDI 6022, sheet 1 (01/2018)
- ✓ DIN 1946, part 4 (09/2018)
- ✓ SWKI VA104-01 (01/2019)
- ✓ SWKI VA105-01 (08/2015)
- ✓ ÖNORM H 6020 (06/2019)
- ✓ ÖNORM H 6021 (08/2016)

Hygiene conformity test

W-365259-22-Zd

Validity period:

02/2023 – 02/2028